
MAYO CLINIC LABORATORIES

HIV Prenatal Testing Algorithm, Including Follow-up of Reactive Rapid Serologic Test Results

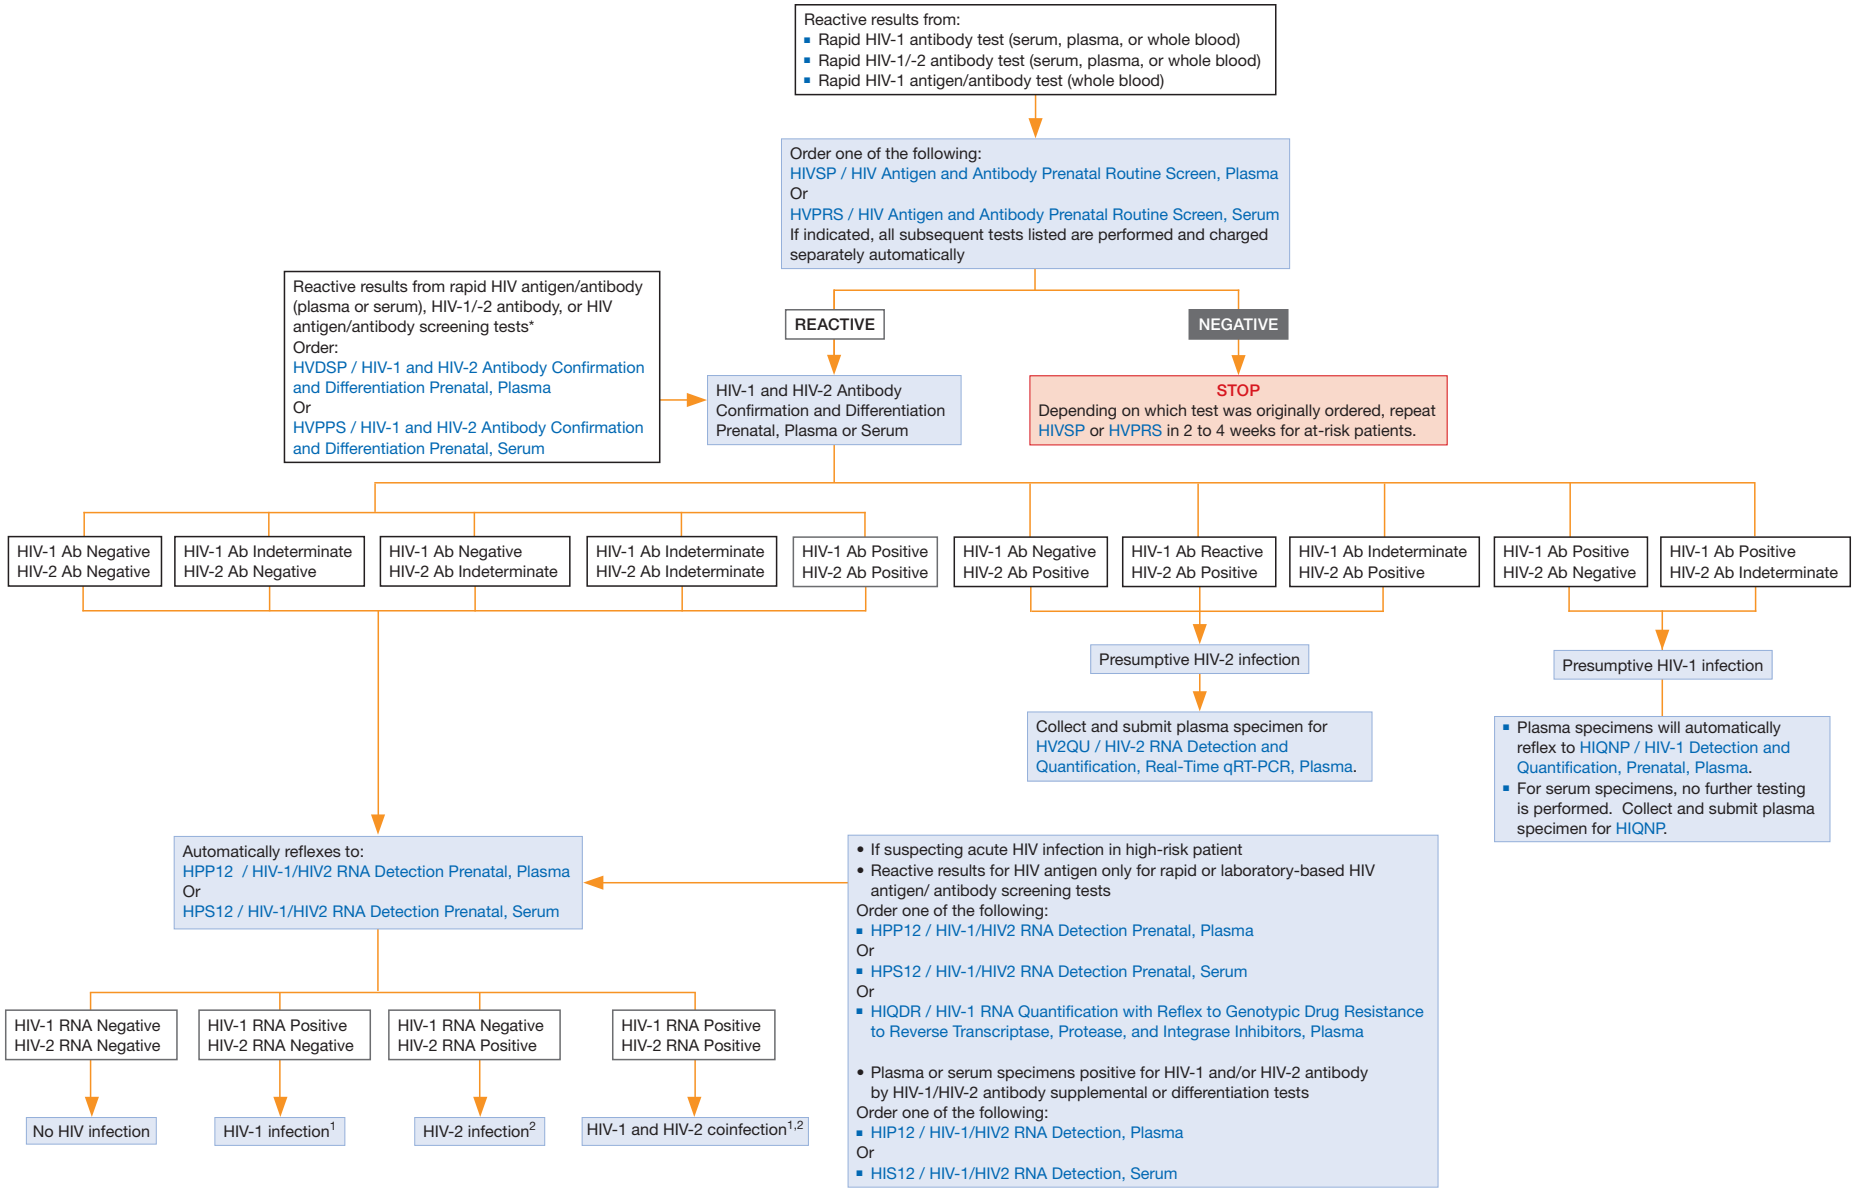

* Plasma or serum specimens from individuals with reactive results from initial rapid HIV, HIV-1/-2 antibody-only, or HIV antigen/antibody combination tests can enter this testing algorithm at HVDSP or HVPPS with applicable downstream testing.

[1] Collect and submit new plasma specimen for HIQNP.

[2] Collect and submit new plasma specimen for HV2QU.

© Mayo Foundation for Medical Education and Research (MFMER). All rights reserved.